




UK Standards for Microbiology Investigations

Review of users' comments received by
Working group for microbiology standards in clinical
bacteriology

TP 30 Potassium hydroxide test

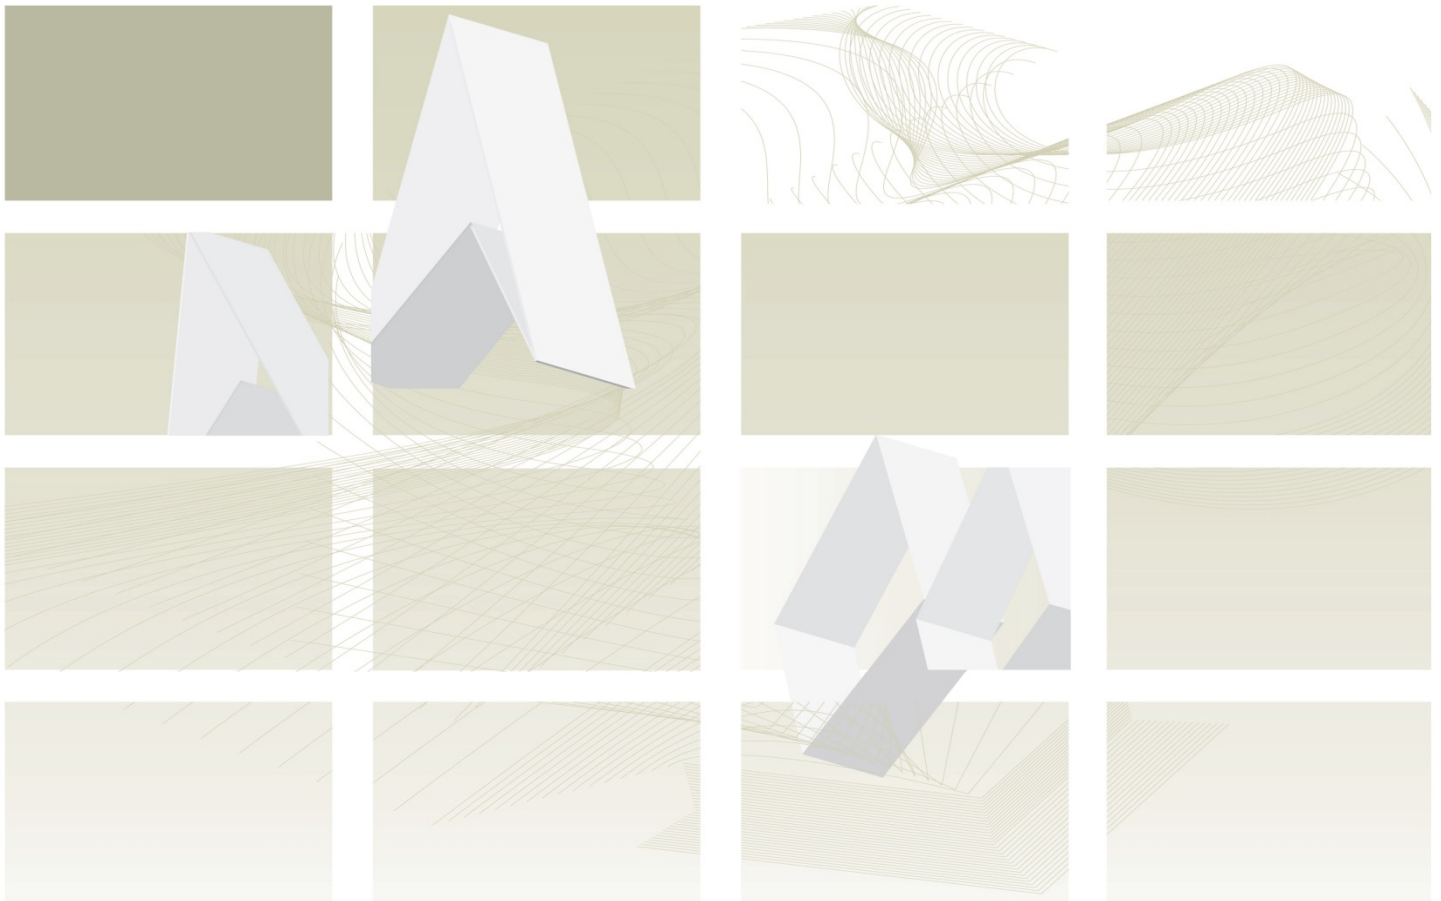

"NICE has renewed accreditation of the process used by **Public Health England (PHE)** to produce **UK Standards for Microbiology Investigations**. The renewed accreditation is valid until **30 June 2021** and applies to guidance produced using the processes described in **UK standards for microbiology investigations (UKSMIs) Development process, S9365', 2016**. The original accreditation term began in **July 2011**."

Recommendations are listed as ACCEPT/ PARTIAL ACCEPT/DEFER/ NONE or PENDING

Issued by the Standards Unit, National Infection Service, PHE

Page: 1 of 2

RUC | TP 30 | Issue no: 2 | Issue date: 02.04.19

Consultation: 23/11/2018 – 07/12/2018

Version of document consulted on: TP 30df+

Respondents indicating they were happy with the contents of the document

Overall number of comments: 1			
Date received	03/12/2018	Lab name/Professional body	The Holly Pathology Laboratory, Buckhurst Hill, Essex
Health benefits			
<i>Not completed.</i>			